

# Installer Friendly Series® In-Site®

## SJE-Rhombus® Type IFI

### Installation Instructions and Operation/Troubleshooting Manual



This control panel must be installed and serviced by a licensed electrician in accordance with the National Electric Code NFPA-70, state and local electrical codes.

All conduit running from the sump or tank to the control panel must be sealed with conduit sealant to prevent moisture or gases from entering the panel. **NEMA 4X enclosures are for indoor or outdoor use**, primarily to provide a degree of protection against corrosion, windblown dust and rain, splashing water and hose-directed water. **Cable connectors must be liquid-tight in NEMA 4X enclosures.**

## Installation

This Installer Friendly Series® In-Site (IFI) control panel was designed to control single phase pump(s). The controller records pump status, number of cycles, elapsed run time, current float status, and float error counts.

NOTE: A heater is required in the panel if operating temperatures are colder than 0 deg F (-18 deg C).

### Mounting the Control Panel

**Note:** The control panel should not be mounted in a location that may be subject to submersion.

1. Determine mounting location for panel. If distance exceeds the length of either the float cables or the pump power cables, splicing will be required. For outdoor or wet installation, we recommend the use of an SJE-Rhombus® liquid-tight junction box with liquid-tight connectors to make required connections. **You must use conduit sealant to prevent moisture or gases from entering the panel.**
2. Mount control panel with mounting devices furnished.
3. Determine conduit entrance locations on control panel. Check local codes and schematic for the number of power circuits required. **(Float cables require separate conduit from power and pump cables.)**

**Note:** Be sure the proper power supply voltage, amperage, and phase meet the requirements of the pump motor(s) being installed. If in doubt, see the pump identification plate for voltage/phase requirements.

4. Drill proper size holes for type of connectors being used.

**Note:** If using conduit, be sure that it is of adequate size to pull the pump cable(s) through.

5. Attach cable connectors and/or conduit connectors to control panel.

**FOR INSTALLATION REQUIRING  
A SPLICE, FOLLOW STEPS 6-10;  
FOR INSTALLATION WITHOUT A  
SPLICE, GO TO STEP 11.**

6. Determine location for mounting junction box according to local code requirements. **Do not** mount the junction box inside the sump or basin.
7. Mount junction box to proper support.
8. Run conduit to junction box. Drill proper size holes for the type of conduit used.

Warranty void if panel is modified.

Call factory with servicing questions:

1-800-RHOMBUS  
(1-800-746-6287)

Manufactured by:

**SJE**  
**Rhombus**®

22650 County Highway 6 ■ P.O. Box 1708  
Detroit Lakes, Minnesota 56502 USA  
1-888-DIAL-SJE (1-888-342-5753)  
Phone: 218-847-1317 ■ Fax: 218-847-4617  
E-mail: customer.service@sjerhombus.com  
Website: www.sjerhombus.com

# Installation Instructions

9. Identify and label each wire before pulling through conduit into control panel and junction box. Make wire splice connections at junction box.
10. Firmly tighten all fittings on junction box.
11. If a junction box is not required, pull cables through conduit into control panel.
12. Connect pump wires per wiring diagram or schematic and float wires to the proper terminals as shown on the schematic.
13. Connect pump, control, and alarm incoming power conductors to proper position on terminals. See schematic for terminal connections.

**VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.**

## Installation of Floats

**CAUTION:** If control switch cables are not wired and mounted in the correct order, the pump system will not function properly. Control switches need to run in separate conduit from pump and power lines.

**WARNING:** Turn off all power before installing pump wires in pump chamber. Failure to do so could result in serious or fatal electrical shock.

1. Determine your normal operating level and desired float configuration, as illustrated in **Figures 2-5**.
2. Mount float switches at appropriate levels. Be sure that floats have free range of motion without touching each other or other equipment in the basin.
3. For mounting clamp installation: place the cord into the clamp as shown in **Figure 1**. Locate the clamp at the desired activation level and secure the clamp to the discharge pipe as shown in **Figure 1**.


**NOTE:** Do not install cord under hose clamp.

4. Tighten the hose clamp using a screwdriver. Over tightening may result in damage to the plastic clamp. Make sure the float cable is not allowed to touch the excess hose clamp band during operation.


**NOTE:** All hose clamp components are made of 18-8 stainless steel material. See your SJE-Rhombus® supplier for replacements.

5. If using an optional redundant off float, mount slightly below the timer enable float.
6. The alarm float can be positioned anywhere that the alarm level is desired.


**Figure 1**

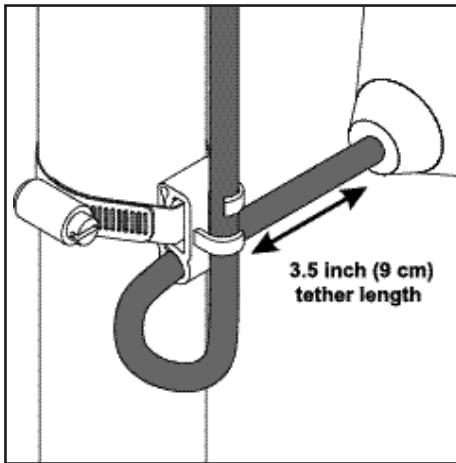


**Figure 2**  
Simplex/Duplex Timed Dose

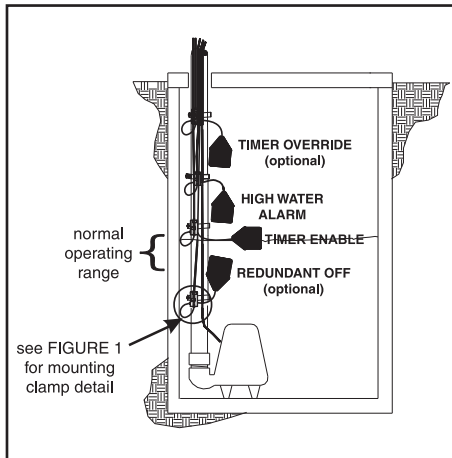


**Figure 3**  
Simplex Demand

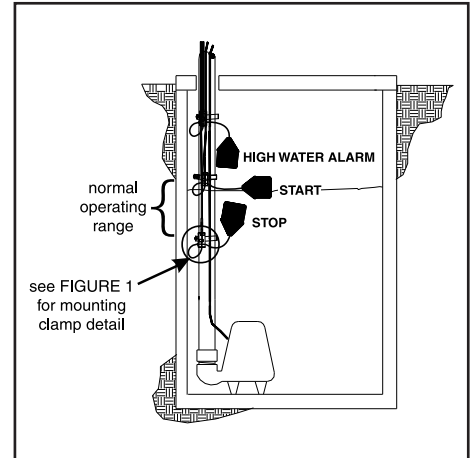

**Figure 4**  
Duplex Demand 3 Float

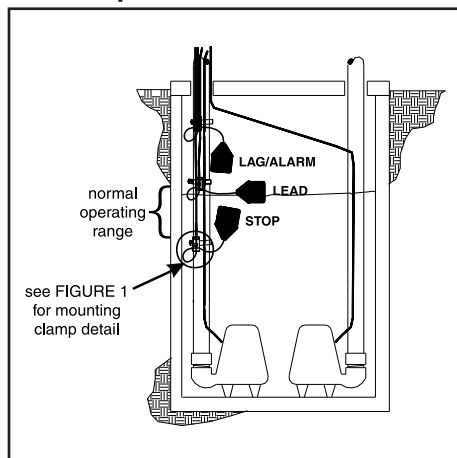

**Figure 5**  
Duplex Demand 4 Float

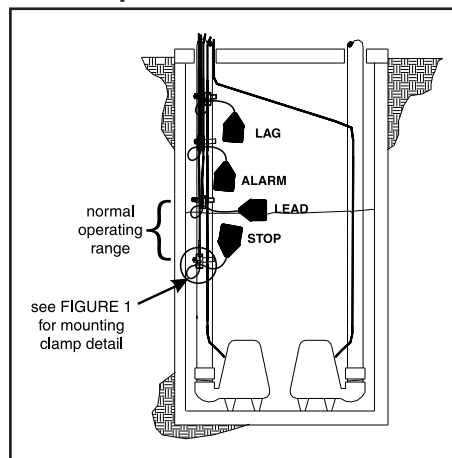

# Operations

The Installer Friendly Series® In-Site® (IFI) control panel uses float switches to continuously monitor and control the liquid level in the tank.

**Hand Operation** - The stop/redundant off float must be raised to put panel in HAND operation. To override the stop/redundant off float, press and hold the HAND button. The pump runs until the HAND button is released. The panel then returns to the AUTO mode. If the stop/redundant off float is raised and the panel is placed in the HAND mode, and left in the HAND mode, the pump continues to run until the stop/redundant off float lowers. The panel then returns to the AUTO mode.

**Off Operation** - The panel is in the OFF mode.

**Auto Operation** - In time dose (t-dose) mode, when the panel is in the AUTO mode, the timer controls pump ON and OFF time as long as the low level float is raised. In demand (d-dose) mode, the stop and start floats control the pump.

**Alarm Count** - Shown on display as "AL-Ctr", counts the number of times the alarm is activated. Note: Alarm counter does not include testing operations in the total count. High alarm, floats out of sequence & auxiliary alarm add to count.

**Green Control and Alarm Power Indicators** - (mounted on interior circuit board) Illuminates when control power and alarm power is present. If the control fuse needs replacing, the panel sounds an alarm.

**Display** - Will turn off after one minute of non-use.

**Float Indicators** - Illuminates if the float is raised. If the float is out of sequence, the panel goes into alarm mode and display shows "FE" float error.

**Timer Override Float** - Overrides the OFF time and pump will run for full dose ON time. (timed dose only, optional)

**Float Error Count** - Shown on the display as "FE-Ct". Counts the number of times floats are out of sequence.

**Timer Override Count** - Shown on the display as "tO-Ct". Counts the number of times the timer override float is activated. (timed dose only)

**Time left in "On" time cycle** - Shown on the display as "t-On". Counts down the time left in the "On" cycle. (timed dose only)

**Time left in "Off" time cycle** - Shown on the display as "t-OFF". Counts down the time left in the "Off" cycle. (timed dose only)

**Auxiliary alarm count**- Shown on the display as "AL1Ctr" or "AL2Ctr". Counts optional auxiliary alarm counts.

## Viewing Panel Settings

With control power supplied to panel:

Press "NEXT" button. The display will show **t-dOSE** for timed dose applications, or **d-dOSE** for demand applications.

Press "NEXT" button. The display will show **Et 1** count in hh:mm.

Press "NEXT" button. The display will show **CC 1** count.

Press "NEXT" button. The display will show **AL1Ctr** count. (Duo auxiliary alarm input option only.)

Press "NEXT" button. The display will show **Et 2** count (pump 2) in hh:mm. (duplex panels only)

Press "NEXT" button. The display will show **CC 2** count. (pump 2) (duplex panels only)

Press "NEXT" button. The display will show **AL2Ctr** count. (Duo auxiliary alarm input option only.)

Press "NEXT" button. The display will show **AL-Ctr** alarm count.

Press "NEXT" button. The display will show **FE-Ct** float error count.

Press "NEXT" button. The display will show **tO-Ct** timer override count. (timed dose mode only)

Press "NEXT" button, The display will flash **On**, then the ON time in hh:mm:ss. (timed dose mode only)

Press "NEXT" button. The display will flash **OFF**, then the OFF time in hh:mm:ss. (timed dose mode only)

Press "NEXT" button. The display will flash either **t-On** or **t-OFF**, then the time left in the ON or OFF cycle. (timed dose mode only)

Press "NEXT" button. The display will flash **SEr**, then the serial number of the In-Site printed circuit board.

## Viewing Date & Time

Note: Check to verify proper date & time are set on system.

Press "UP" button until **SEt dt** is displayed.

The display will flash **dAtE** then mo:dy:yr.

Press "NEXT" button.

The display will then flash "Hour" the hr:mn: A (A.M.) or P (P.M.)

Note: If date and/or time is incorrect, follow "Homeowner Date and Time Setting" label inside front cover.

## Program Timer On & Off Times

With control power supplied to panel:

Press and hold "SET" button for 3 seconds until **Prog** is displayed.

The display will flash **On**, then the time in hh:mm:ss.

## Setting pump ON (follow Section A)

### Section A

Press "SET" button to display time in hh:mm:ss.

Press "NEXT" button until desired digit flashes

Press "UP" button until desired time is achieved.

Repeat process pressing "NEXT" and "UP" buttons until desired time is reached.

Press "SET" button to save.

# Operations

## Setting pump OFF times

Press "NEXT" button. The display will flash **OFF** and show the OFF time in hh:mm:ss. **Repeat the instructions in Section A to set OFF times.**

Press and hold "SET" button for 3 seconds until **run** is displayed.

Timer programming is complete.

## Program Pump Sequence

Program Pump sequence "Alt", "2-1" or "1-2" (duplex only)

With control power supplied to panel:

Press and hold "SET" button for 3 seconds until **Prog** is displayed.

Press "NEXT" button until **ALtErn** flashes with either **ALt**, **2-1**, or **1-2** flashing.

Press "SET" button to display **ALt**, **2-1**, **1-2**.

Press "UP" button until desired sequence is achieved.

Press and hold "SET" button for 3 seconds until **run** is displayed.

## Installer Setting the Date and Time

Press and hold "SET" button until **Prog** is displayed, then release switch.

Press "NEXT" switch until **dAtE** is displayed (MM:DD:YY).

Press "SET" switch.

Press "UP" and "NEXT" switches until desired date is displayed.

Press "SET" switch until audible beep is heard.

Press "NEXT" switch until **Hour** is displayed (24 hr clock).

Press "SET" switch.

Press "UP" and "NEXT" switches until desired time is displayed.

Press "SET" switch until audible beep is heard.

Press and hold "SET" switch until **run** is displayed.

NOTE: An audible beep will sound if the date and time are not properly set.

## Data Extraction Instructions

1. Press "MANUAL REPORT" switch until audible beep sounds then release switch.

2. Place flash drive into port.

**Note: Use only memory stick provided by SJE- Rhombus.**

- LED on port will flash green during data download.
- LED on port will glow solid green when data download is complete.
- Audible one second on/one second off beep sequence will occur if download is successful.
- Remove flash drive.

Data download is complete.

Note: If at anytime during the data extraction process a rapid beep sequence occurs, remove memory stick and retry data extraction instructions at step 2.

## Selecting Time Dose or Demand Dose

### -Panels in the field

To set the panel to either Timed Dose or Demand Dose in the field:

- Turn the control/alarm power off to the control panel.
- Turn the pump power off to the control panel.
- Place a small screwdriver or pen into the slot in the label on the inner door marked "DEMAND DOSE TIMED DOSE".
  - Move the dip switch (up) for demand dose
  - Move the dip switch (down) for Timed dose
- Turn the control/alarm power on to the control panel. After the display goes blank press the "NEXT" switch.
  - The display will show d-dose for demand dose.
  - The display will show t-dose for timed dose.**WARNING:** Changing the dip switch positions will change the operation of the panel.  
**WARNING:** If changing to timed dose, be sure to set the off and on times.
- Turn on the pump power after all the settings are changed.
- WARNING:** Check the panel for correct operation before leaving the site.

# Troubleshooting

## Float Controls

- Check the floats during their entire range of operation. Clean, adjust, replace and repair damaged floats.
- Measure the float resistance to determine if the float is operating properly.

To measure float resistance:

- Isolate the float by disconnecting one or both of the float leads from the float terminals.
- Place one ohmmeter lead on one of the float wires, and the other ohmmeter lead on the other float wire.
- Set the ohmmeter dial to read ohms and place on the R X 1 scale. With the float in the "off" position, the scale should read infinity (high resistance), if not replace the float.

With the float in the "on" position, the scale should read close to zero, if not replace the float. **Readings may vary depending on the accuracy of the measuring device.**

## Magnetic Contactor Coil

To measure the coil, disconnect one of the coil leads. Measure the coil resistance by setting the ohmmeter on the R X 1 scale. A defective coil will read zero indicating a short, or infinity (high resistance) indicating an opened coil. Replace defective contactor.

## Fuse

To check the continuity of the fuse, pull the fuse out of the fuse holder. With the ohmmeter on the R X 1 scale, measure resistance. A reading of infinity (high resistance) indicates a blown fuse that must be replaced with a fuse of the same type, voltage, and amp rating.

## Alarm Light

With power on, hold the test/normal/silence switch in the "test" position. The alarm light should turn on. If not, replace the light with that of the same type.

## Alarm Horn

With power on, hold the test/normal/silence switch in the "test" position. The alarm horn should turn on. If not, replace the horn with that of the same type.



